

Evaluation of Existing DC Protection Solutions on an Active LVDC Distribution Network under Different Fault Conditions

Dong WANG, Abdullah EMHEMED, Patrick NORMAN, Graeme BURT,
University of Strathclyde – UK
d.wang@strath.ac.uk

ABSTRACT

Low Voltage Direct Current (LVDC) distribution is considered as one of the new promising technologies for better integration of distributed generation, and supplying local loads in more efficient way compare to AC systems. However, DC protection is still considered as one of the outstanding challenges that holds back the wide deployment of LVDC in last mile utility applications. Most of existing DC solutions have been developed for specific applications such as data centres, PV systems, electric ships, and traction systems. However, their suitability for providing a good level of protection and safety for an LVDC last mile public network is still not fully understood. Therefore, this paper evaluates the performances of a wide number of DC protection solutions that have been proposed for the applications on an active LVDC last mile distribution network with local generation sources (including PVs and battery storages). Based on the findings, recommendations of LVDC protection for resilient operation are presented in the paper.

INTRODUCTION

The requirements for clean energy and more efficient power distribution systems have stimulated the interest in Low Voltage Direct Current (LVDC) distribution network. LVDC distribution systems have already been introduced for powering certain applications such as data centres, information communication systems, electric traction systems, and electric ships. Using DC infrastructure with such applications will eliminate the losses caused by AC to DC conversion for supplying DC loads [1]. However, DC fault protection is still considered as one of the outstanding challenges that hold back the wide deployment of LVDC in the last mile utility applications [2]. Many researches have concluded that traditional LV protection solutions that have been used for existing LVAC will require longer time for detecting and clearing DC faults, resulting in the requirement for equipment with higher ratings [3]. For other related DC applications such as HVDC transmission, marine systems, DC microgrids, and data centres, different DC protection solutions have been developed [4]-[12]. However, the suitability of such solutions for providing a good level of protection and safety for an active LVDC last mile distribution network is still not clear. There is still no real application of LVDC last mile with the lack of mature protection solutions in this field. Therefore, using simulation and detailed models of

LVDC and associated power electronics converters, this paper extensively evaluates the performances of different existing DC protection solutions on an LVDC last mile distribution network with local generation sources. The paper outlines the challenges and opportunities for using such existing solutions for LVDC last mile networks.

EXISTING DC PROTECTION SOLUTIONS

Existing non-unit and unit DC protection solutions are discussed as follows.

Non-unit Protection

DC overcurrent protection is a current-based protection that has been widely used in different DC systems. Delta criteria based protection is proposed for meshed HVDC grid comparing the current and voltage measurements of positive pole and negative pole to detect the DC fault [5]. More advanced DC protection solutions have been introduced to improve the selectivity of overcurrent protection. For example, rate of change of current based protection that is using local measurements to analyse the rate of change of current to detect and locate DC faults [6]. Also, signal processing techniques (i.e. Fast Fourier transform and wavelet transform) have been used for protecting DC marine systems [7], HVDC [8], and LVDC grids [9]. Moreover, converter coordinated protection has been introduced for protecting DC microgrid using fault tolerant converters and contactors to reconfigure the DC network to ride through DC fault conditions [10].

Unit Protection

With respect to unit protection, DC differential protection has been investigated by many researches for protecting LVDC microgrids. Fast DC differential protection (within 10 μ s) can be achieved by using communication links and solid state circuit breakers [11]. Also, fast directional based DC protection (1 ms communication delay + 30 μ s) has been proposed for an LVDC last mile distribution network [12].

DC Fault Interruption Devices

There are main four types of devices that can be used for interrupting DC faults. These include fuses, mechanical breaker such as molded-case circuit breakers (MCCB) and miniature circuit breaker (MCB), solid-state circuit breakers (SSCB), and hybrid SSCB. Fuse based technologies have been introduced for protecting solar photovoltaic such as Eaton Bussmann series [13]. MCCB

and MCB have already been available in the market that are used for protecting DC-powered data centres [14]. The SSCBs use semiconductor switches such as GTO, IGCT, IGBT, and MOSFET to obtain the fast fault isolation (in few μs [15]). Comparatively, hybrid SSCB consists of the mechanical contactor and semiconductor switches to provide the effective and fast DC fault isolation [16]. SSCBs and hybrid SSCB are not widely used and still at an early stage of development.

EVALUATION OF EXISTING PROTECTION TECHNOLOGIES FOR PROTECTING AN ACTIVE LVDC DISTRIBUTION NETWORK

This section evaluates the effectiveness of DC overcurrent, differential, directional, and rate of change of current protection solutions for protecting future LVDC distribution networks. A detailed model of LVDC distribution network is developed in PSCAD/EMTDC and used as a test network, and simulation studies are conducted to test the performances of each aforementioned protection on the developed test network. The modelling and simulation works are introduced in the following sections.

Modelling an Active LVDC Distribution Network

The developed test network is based on the LVDC model established in [17] and shown in Fig. 1. The network is supplied from 11 kV AC source with fault level 156 MVA and $X/R=5$. The LVDC network is connected to the secondary substation of 11kV/0.4 kV transformer through two-level voltage source converter (VSC). The VSC provides 750 Vdc (± 375 Vdc) with midpoint grounding which facilitates the detection of ground faults [18]. Two 1 km feeders are modelled with a resistor ($R=0.164 \Omega/\text{km}$) connected in series with an inductor ($L=0.24 \text{ mH}/\text{km}$) [17].

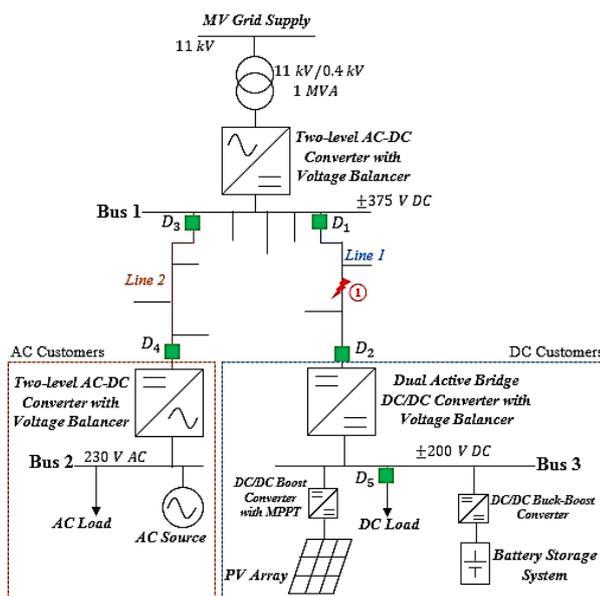


Fig. 1. LVDC Distribution Network Test Model.

The model configurations of the VSCs, battery, and PV with their associated controls are presented by the authors in [19]. In this paper, an isolated dual active bridge (DAB) DC-DC converter and voltage balancers are used to represent the DC-DC converters. The DAB converter is more flexible for different grounding configurations and has better fault management capability than the basic half bridge DC/DC converter [20]. The converter topology is given in Fig. 2, and the associated close loop control is given in Fig. 3 [20]. The parameters of DAB converter are illustrated in Table 1.

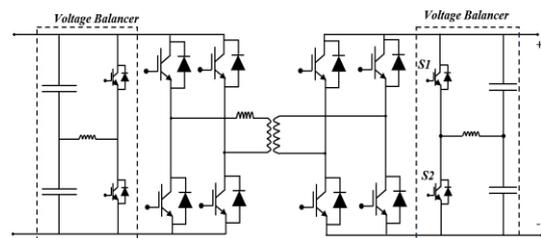


Fig. 2. Circuit diagram of DAB converter with voltage balancer.




Fig. 3. Control diagram of DAB [20].

Table 1 Parameters of dual active bridge converter.

	Value
DC Capacitor	3300 μF
Switching Frequency	500 Hz
DC Voltage	750 V (± 375 V)/400 V (± 200 V)

The voltage balancer as presented in Fig. 2 is used with the two-level VSC and the DAB DC-DC converters to ensure DC voltage balance between the poles and the operation of the LVDC under unbalanced loading conditions. The control of voltage balancer is presented in Fig. 4. The $V_{dc}/2$ is measured and compared to V_n (voltage of negative pole), and the difference is processed through PI and PWM techniques to generate the required control signals for the balancer.

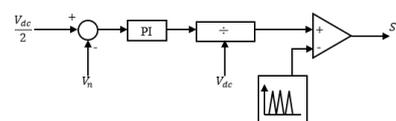


Fig. 4. Control diagram of voltage balancer [21].

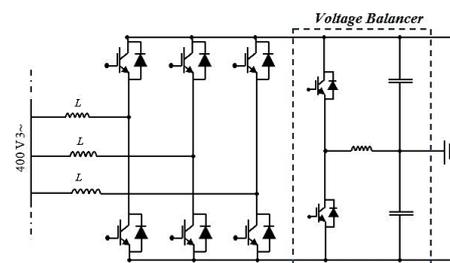


Fig. 5. Two-level VSC with voltage balancer.

Evaluation of DC Protection

In this evaluation, DC pole to pole (P-P) and positive pole to ground (P-G) faults are applied at location 1 (middle of line 1) as shown in Fig. 1, which occur at 1.5 s. The following part will illustrate the performances of DC overcurrent, differential, directional, and rate of change of current based protection solutions under such fault conditions. Also, converter impacts on the effectiveness of these protection schemes will be investigated.

DC Overcurrent based Protection

Overcurrent protection is modelled as an inverse-time overcurrent relay that is selected with extremely inverse of IEEE Std. C37.112, and threshold setting of D1 and D2 are 1.4 p.u. and 1.3 p.u. respectively. The breaker is modelled with 10 ms time delay for arc extinction [22]. During the location 1 P-P fault, D1 overcurrent protection is relatively slow (213 ms) to clear the fault that results in the system experiences the significant transient (1.446 kA) and steady state (0.38 kA) fault currents as presented in Fig. 6, and these lead to the high fault let through energy (FLTE, $\int_0^t I^2 dt$) (36800 A^2s for the cable, 35000 A^2s for the grid AC/DC converter). At the D2 side, the steady state fault current is limited by DAB converter, and only the transient current spike is experienced. The transient and limited steady state fault currents are not enough for the overcurrent protection to operate as illustrated in Fig. 7. Also, in the positive P-G fault condition, the fault current only has the transient discharge (1.435 kA) as manifested in Fig. 8 that is also not enough for overcurrent protection to operate. This increases the risk of damage to the devices connected to the healthy pole as the operation voltage becomes double as shown in Fig. 9.

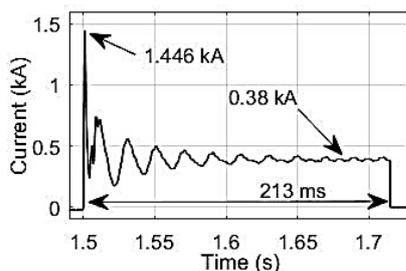


Fig. 6. Fault current measured at D1 with overcurrent protection during the location 1 P-P fault condition.

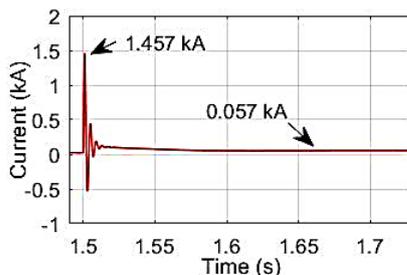


Fig. 7. Fault current measured at D2 with overcurrent protection during the location 1 P-P fault condition.

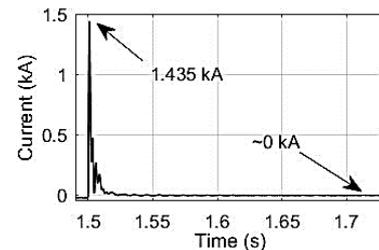


Fig. 8. Fault current measured at D1 with overcurrent protection during the location 1 positive P-G fault condition.

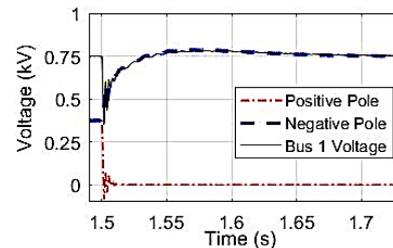


Fig. 9. Bus 1 voltage with overcurrent protection during the location 1 P-G fault condition.

DC Differential based Protection

Differential protection is modelled following the configuration introduced in [11] with 20% of normal current as the threshold, and solid state circuit breaker is modelled with 1 μs delay [15]. In the location 1 P-P fault condition, fast protection (fault current stops increasing in 4 μs) can be achieved that results in the smaller current spike (0.0473 kA) and lower FLTE (only 0.0088 A^2s for the cable) as shown in Fig. 10. Also, during the location 1 P-G fault, the voltage of bus 1 can be maintained to the normal voltage level. However, in this test bed, with 20 % threshold setting, 12 μs communication delay can cause mal-trips during the external fault conditions. With respect to the high resistive fault detection capability, 20% threshold is capable of detecting 50 Ω fault.

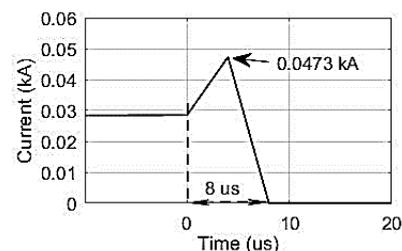


Fig. 10. Fault current measured at D2 with differential protection during the location 1 P-P fault condition.

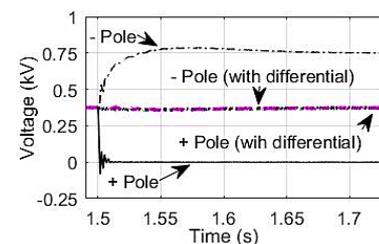


Fig. 11. Bus 1 voltage with differential protection during the location 1 P-G fault condition.

DC Directional based Protection

Directional based protection is configured following the instructions in [12] with the solid state circuit breakers. Using DC directional protection, fast DC fault protection can be achieved, and the relative current and voltage performances under location 1 P-P and P-G fault conditions are similar as shown in Fig. 10-Fig. 11. However, communication delay is also an issue for directional based DC protection that could result in the mal-operations. Moreover, high resistive fault detection is a significant issue for directional protection. Fig. 12 shows the current measurement at D1 under location 1 P-G fault. In this test bed, any line 1 P-G faults with resistance higher than 16.7 Ω have the same current direction as the normal operation, which makes directional protection blind.

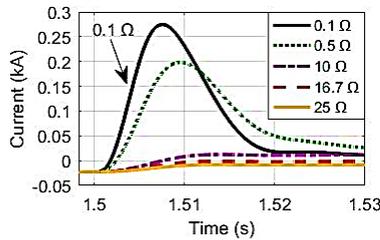


Fig. 12. Current measurement at D1 under location 1 P-G fault conditions with different fault resistances.

DC Rate of Change of Current based Protection

Rate of change of current (di/dt) based protection is modelled following [6] with solid state circuit breaker. For example, the threshold setting for the line 1 protection can be calculated as shown in Eq.1, where, $V_c(0)$ and $i_L(0)$ are voltage and current in the normal operation, R and L are the resistor and inductor of the faulted circuit.

$$\begin{aligned} \frac{di}{dt} &= \frac{V_c(0) - i_L(0) \times R}{L} \\ &\approx \frac{V_c(0)}{L} = \frac{750 \text{ V}}{0.00048 \text{ H}} = 1562500 \text{ (A/s)} \end{aligned} \quad \text{Eq.1}$$

Using this scheme, DC short circuit fault can be detected and located with high accuracy, and fault can be cleared at the early stage of the current transient. The current and voltage profiles during location 1 P-P and P-G faults are similar as shown in Fig. 10-Fig. 11. However, data acquisition will be a challenge for this scheme. If the measurement misses the transient point, fault detection and location will come with intolerant errors as shown in Fig. 13 (i.e. 0.5 ms measurement delay leads to protection blind). Moreover, using the simplified equation to estimate high resistive fault, errors will be encountered because it neglects the effect of $i_L(0) \times R$ of the original equation. The error can be calculated as depicted in Eq.2. For example, in location 1 P-P fault condition, distance error and fault resistance can be illustrated in Fig. 14, di/dt is very sensitive to fault resistance (i.e. 11 Ω leads to 50 % estimation error).

$$\text{Error} = \frac{i_L(0) \times R}{V_c(0) - i_L(0) \times R} \quad \text{Eq.2}$$

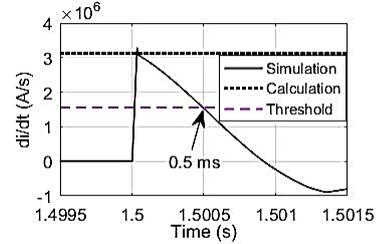


Fig. 13. Measured and calculated di/dt in the D1 side when P-P fault happens in location 1.

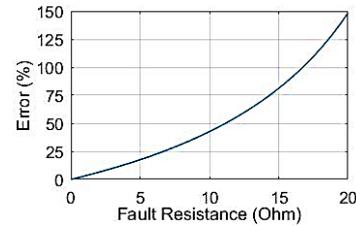


Fig. 14. di/dt error with fault resistance in the location 1 P-P fault condition.

Discussion

Mechanical circuit breaker (CB)-based overcurrent (O/C) protection schemes have already been widely used for protecting DC applications. However, their relatively slow performances (i.e. 213 ms) will require the network cables and associated power electronics converters to be designed with higher ratings and larger sizes to withstand fault currents within such duration (i.e. FLTE 35000 A^2s for the grid AC/DC converter). In addition, the results also show mechanical CB-based inverse-time graded O/C protection did not operate for DC faults controlled by dual active bridge DC/DC converters. This is because, the fault during the steady state current phase will be limited to a very low value (0.057 kA) which is not enough to trigger the CB. Comparatively, SSCB-based DC protection solutions (e.g. differential, directional, and rate of change of current) can achieve fast DC fault protection with speed close to 8 μs . This will allow the use of equipment with lower short circuit ratings (0.0088 A^2s FLTE). However, the cost and losses of SSCB still remain as outstanding issues, and low voltage SSCBs are still at research stages [15]. There is a trade-off between having a cheap mechanical CB-based O/C protection with high cost converters and using fast SSCB-based protection with added losses to the systems. As for communication-based DC protection solutions, differential protection is more effective than other methods (such as overcurrent, directional, and rate of change of current based DC protection solutions) for detecting DC faults (especially high resistive faults). For example, 50 μs fault can be detected and cleared within 10 μs .

In the future, fault tolerant converters (such as modular multilevel converter and dual active bridge converter) are likely to be widely deployed with LVDC distribution systems. Such technologies will allow the use of lower rating power electronic devices with reduced cost [23]. This will require an effective coordination between the

converters and downstream DC protection schemes to achieve an enhanced DC fault detection, location, and interruption at low fault level currents.

CONCLUSIONS

The paper has investigated the effectiveness of existing protection solutions that included DC overcurrent, differential, directional, and rate of change of current based protection solutions. Currently, in terms of fast speed requirements and high resistive DC fault detection, differential protection with SSCB is the promising solution compare to other methods such as inverse-time graded O/C protection. The challenge with differential protection is the cost where high speed and fidelity communications, intelligent electronic devices, and SSCBs are required. In addition, O/C protection is hard to detect and interrupt the reduced fault currents caused by fault tolerant converters. For future LVDC distribution power systems, when fault tolerant converters are widely used, new protection techniques such as active-based methods will be more attractive to provide the required advanced DC protection. This field will indeed need further research and tests.

REFERENCES

- [1] A. T. Elsayed, et al "DC microgrids and distribution systems: an overview" *Electric Power Systems Research*, 15 Nov 2015.
- [2] A. Emhemed, "An advanced protection scheme for enabling an LVDC last mile distribution network," *IEEE Transaction on Smart Grid*, vol. 5, no. 5, Sep 2014.
- [3] T. Dragicevic, et al, "DC microgrids-part II: a review of power architectures, applications, and standardization issues," *IEEE Transactions on Power Electronics*, vol. 31, no. 5, Aug 2015.
- [4] M. Farhadi, et al, "Protection of multi-terminal and distributed DC systems: design challenges and techniques," *Electric Power System Research*, 29 Oct 2016.
- [5] A. K. Marten, et al "Non-telecommunication based DC line fault detection methodology," *AC and DC Power Transmission*, 11th IET International Conference, 12 Feb 2015.
- [6] A. Meghwani, et al, "A non-unit protection scheme for DC microgrid based on local measurements," *IEEE Transaction on Power Delivery*, 21 Apr 2016.
- [7] E. Christopher, et al "Fault location in a zonal DC marine power system using active impedance estimation," *IEEE Transactions on Industry Application*, vol. 49, no. 2, Mar 2013.
- [8] O. Nanayakkara. et al, "Travelling-wave-based line fault location in star-connected multiterminal HVDC system," *IEEE Transaction on Power Delivery*, vol. 27, no. 4, Oct 2012.
- [9] K. A. Saleh, et al "Hybrid passive-overcurrent relay for detection of faults in low-voltage DC grids," *IEEE Transaction on Smart Grid*, Sep 2015.
- [10] P. Caioli, et al "Coordinated control of the bus tie switches and power supply converters for fault protection in DC microgrids," *IEEE Transactions on Power Electronics*, Apr 2013.
- [11] S. Fletcher, et al "High-speed differential protection for smart DC distribution systems," *IEEE Transaction on Smart Grid*, vol. 5, no. 5, Sep 2014.
- [12] A. Emhemed, et al "Validation of fast and selective protection scheme for an LVDC distribution network," *IEEE Transaction on Power Delivery*, Jul 2016.
- [13] Eaton, "Complete and reliable solar circuit protection," Jan 2016, available at: www.eaton.com.
- [14] ABB, "Technical application papers No. 5 ABB circuit-breakers for direct current application," 12 Sep 2011, available: www.abb.com.
- [15] Z. J. Shen, et al, "Solid state circuit breakers for DC microgrids: current status and future trends," *ICDCM*, 2015 IEEE First International Conference, 10 June 2015.
- [16] W. Hauer, et al "A novel low voltage grid protection component for future smart grid," *UPEC 2016*, Sep 2016.
- [17] A. Emhemed, et al "An advanced protection scheme for enabling an LVDC last mile distribution network", *IEEE Transaction on Smart Grid*, vol. 5, no. 5, Sep 2014.
- [18] J. Karppanen, et al "Effect of voltage level selection on earthing and protection of LVDC distribution systems," *AC and DC Power Transmission*, 11th IET International Conference, 10-12 Feb 2015.
- [19] D. Wang, et al "Fault analysis of an active LVDC distribution network for utility applications," *UPEC 2016*, Sep 2016.
- [20] B. Zhao, et al "Overview of dual-active-bridge isolated bidirectional DC-DC converter for high-frequency-link power-conversion system," *IEEE Transaction on Power Electronics*, vol. 29, no. 8, Aug 2014.
- [21] B. Han, et al "A half-bridge voltage balancer with new controller for bipolar DC distribution systems," *Energies*, 10 Mar 2016.
- [22] R. Ma, et al "Investigation on arc behaviour during arc motion in air DC circuit breaker," *IEEE Transaction on Plasma Science*, vol. 41, no. 9, Sep 2013.
- [23] L. Qi, et al "Design issues and practical application challenges of DC shipboard distribution system protection," *Electric Ship Technologies Symposium*, 2015 IEEE, 16 July 2015.